

06701-06710-07701-07710

Prepared to OSHA, ACC, ANSI, NOHSC, WHMIS, 2001/58 & 1272/2008/EC Standards SDS Revision: 1.0 SDS Revision Date: 05/02/2018

_						
	1. PRODUCT & COMPANY IDENTIFICATION					
1.1	Product Name:	Kenra Professional Fast Dry Hairspray				
1.2	Chemical Name:	Aerosol hairspray				
1.3	Synonyms:	Kenra Professional Fast Dry Hairspray 55VOC – B-9427B				
1.4	Trade Names:	Kenra Professional Fast Dry Hairspray				
1.5	Product Uses/ Restrictions	Professional and Cosmetic Use				
1.6	Distributor's Name:	KIK Custom Products				
1.7	Distributor's Address:	2030 Old Candler Road, Gainesville, GA 30507 USA				
1.8	Emergency Phone:	CHEMTEL: +1 (703) 527-3887 / +1 (800) 424-9300				
1.9	Business Phone / Fax:	+1 (770) 534-0300 / +1 (770) 534-8954				

2. HAZARDS IDENTIFICATION

2.1 Hazard Identification: This product is classified as a HAZARDOUS by the 2012 OSHA Hazard Communication Standard (29CFR 1910.1200)

WARNING! FLAMMABLE AEROSOL. PRESSURIZED CONTAINER: MAY BURST IF HEATED. HIGHLY FLAMMABLE LIQUID AND VAPOR. CAUSES EYE IRRITATION.

Classification: Level 1 Aerosol; Category 2 Flammable Aerosol

Hazard Statements:

Flammable Aerosol- Category 2

Gases under Pressure – Liquefied Gas

Causes eye irritation -Category 2 - Sub category B

<u>Precautionary Statement</u> (P): Keep away from heat, hot surfaces, sparks, open flames and other ignition sources. No Smoking. Do not spray on an open flame or other ignition source. Do not pierce or burn, even after use.

<u>Precautionary Statements – response</u>: Avoid breathing vapors/spray. Use only in well-ventilated area. IF INHALED; Remove person to fresh air and keep comfortable for breathing. IF IN EYES; Rinse cautiously with water for several minutes. Remove contact lenses, if present, continue rinsing. If eye irritation persists: Get medical advice/attention.

<u>Precautionary Statements – Storage</u>: Protect from sunlight. Do no expose to temperature exceeding 48°C (120 °F). Keep product locked up and out of reach of children. Store in well ventilated areas.

<u>Precautionary Statements – Disposal</u>: Dispose of contents/container to licensed and permitted disposal or recycling facility.

<u>Hazards not otherwise classified (HNOC)</u>

Not Applicable



3. COMPOSITION & INGREDIENT INFORMATION

Substance / Chemical Name(s)	CAS No.	S No. EINECS No.		Other			
DIFLUOROETHANE (R-152a)	75-37-6	200-866-1	10 – 30	Flam. Gas 1; H220			
Dimethyl Ether	115-10-6	204-065-8	10 - 30	Press. Gas 1; Flam. Gas 1; H220			
Ethanol (SD Alcohol 40B)	64-17-5	200-578-6	25 - 55	Flam. Lig. 2; H225			

4. FIRST AID MEASURES

4.1	First Aid:	Ingestion:	If ingested, do not induce vomiting! If product has been swallowed, drink plenty of water or milk IMMEDIATELY. If the patient is vomiting, continue to offer water or milk. Never give water or milk to an unconscious person. Contact the nearest Poison Control Center or local emergency number. Provide an estimate of the time at which the material was ingested and the amount of the substance that was swallowed.
		Skin:	If irritation occurs & product is on the skin, rinse thoroughly with lukewarm water, followed by a thorough washing of the affected area with plenty of soap and water. Remove contaminated clothing and wash thoroughly before ruse. If irritation, redness or swelling persists, consult a physician immediately.
		Eyes:	If product get in the eyes, flush with copious amounts of lukewarm water for at least 15 minutes. Raise and lower eyelid(s) while flushing to ensure thorough irrigation. If problems persist seek immediate medical attention.
		Inhalation:	Remove victim to fresh air and keep comfortable for breathing.
4.2	Effects of Exposure:	Ingestion:	If product is swallowed, may cause nausea, vomiting and/or diarrhea and central nervous system depression.



06701-06710-07701-07710

		Skin:	May be irritating to skin. The product can cause allerg some sensitive individuals upon prolonged or repeated		ns (e.g., rashes, w	elts, dermatitis) ir				
		Eyes:	Moderately irritating to the eyes.							
		Vapors of this product may be moderately irritating to the nose, throat and other tissues of the								
		respiratory system. Symptoms of overexposure can include coughing, wheezing, nasal congestion,								
			difficulty breathing. Inhalation of concentrated vapors	s can cause ne	rvous system dep	ression (e.g.,				
1.2	Symptoms of Overexposure	Ingostions	drowsiness, dizziness, headaches, nausea).	ral namenta sus	stom donrossion					
4.3	Symptoms of Overexposure	<u>Ingestion:</u>	May cause nausea, vomiting and/or diarrhea and central nervous system depression. Prolonged contact with skin may result in bleaching and irritation of skin. The product can cause allergic							
		Skin:	skin reactions (e.g., rashes, welts, dermatitis) in some sensitive individuals. Symptoms of skin							
			overexposure may include redness, itching, and irritation of affected areas.							
		E	Overexposure in eyes, may cause redness, itching and watering (risk of serious damage to eyes) Contact							
		<u>Eyes:</u>	may cause mild eye irritation including stinging, water	ing and rednes	SS.					
		<u>Inhalation:</u>	Symptoms of overexposure can include coughing, whe	ezing, nasal co	ongestion, and dif	ficulty breathing.				
1.4	Acute Health Effects:		itation to eyes and skin near affected areas. Additionall	y, high concen	trations of vapors	s can cause				
	Acate Health Effects.		dizziness, headaches and nausea.							
			or chronic health effects are expected to occur from a sir	-	-	-				
4.5	Chronic Health Effects:	_	skin and mucous membrane of the eye and respiratory sy							
		allergic derm	some sensitive individuals. May also induce skin sensiti	zation and res	piratory hyperser	isitivity. Possible				
1.6	Target Organs:		espiratory system.							
7	Medical Conditions		hazards may be delayed. Most common symptoms	HEALTH		1				
	Aggravated by Exposure		ting properties to eyes, respiratory system and skin.	FLAMMABILI	TY	3				
			natological conditions (such as eczema) and respiratory	PHYSICAL HA	ZARDS	0				
			uch as bronchial asthma and/or bronchitis) may be	PROTECTIVE	В					
		and a substantial and								
		exacerbated		EYES	SK IN					
		exacerbated		EYES						
		exacerbated	5. FIREFIGHTING MEASURES	EYES						
5.1	Fire and Explosion Hazards:				IN .					
5.1	Fire and Explosion Hazards:	Level 1 Aero uninvolved c	5. FIREFIGHTING MEASURES sol (NFPA 30B). Aerosols may burst at temperatures abountainers to prevent possible bursting. Aerosols may be	ove 120° F (48° e projectile haz	C). Cool ards when					
5.1	Fire and Explosion Hazards:	Level 1 Aero uninvolved of bursting. If a	5. FIREFIGHTING MEASURES sol (NFPA 30B). Aerosols may burst at temperatures abountainers to prevent possible bursting. Aerosols may be perosols are bursting, stay clear until bursting is complete	ove 120° F (48° e projectile haz e. Containers i	C). Cool ards when may rupture					
5.1	Fire and Explosion Hazards:	Level 1 Aero uninvolved o bursting. If a and release	5. FIREFIGHTING MEASURES sol (NFPA 30B). Aerosols may burst at temperatures about ontainers to prevent possible bursting. Aerosols may be aerosols are bursting, stay clear until bursting is complete flammable liquids and/or exposed gases if exposed to the	ove 120° F (48° e projectile haz e. Containers i e heat of fire.	C). Cool ards when may rupture					
		Level 1 Aero uninvolved of bursting. If a and release containers of	5. FIREFIGHTING MEASURES sol (NFPA 30B). Aerosols may burst at temperatures about an advantage on tainers to prevent possible bursting. Aerosols may be derosols are bursting, stay clear until bursting is complete flammable liquids and/or exposed gases if exposed to the bool by spraying them with water until the fire has been exposed.	ove 120° F (48° e projectile haz e. Containers i e heat of fire.	C). Cool ards when may rupture					
5.2	Extinguishing Methods:	Level 1 Aero uninvolved of bursting. If a and release of containers of Water Fog, F	5. FIREFIGHTING MEASURES sol (NFPA 30B). Aerosols may burst at temperatures about ontainers to prevent possible bursting. Aerosols may be perosols are bursting, stay clear until bursting is completed flammable liquids and/or exposed gases if exposed to the pool by spraying them with water until the fire has been enoam, CO ₂ , Dry Chemical	ove 120° F (48° e projectile haz e. Containers e heat of fire. extinguished.	C). Cool ards when may rupture Keep	3				
5.2		Level 1 Aero uninvolved of bursting. If a and release of containers of Water Fog, F As in any fire	5. FIREFIGHTING MEASURES sol (NFPA 30B). Aerosols may burst at temperatures about ontainers to prevent possible bursting. Aerosols may be perosols are bursting, stay clear until bursting is completed flammable liquids and/or exposed gases if exposed to the pool by spraying them with water until the fire has been en coam, CO ₂ , Dry Chemical et approved self-contained breathing	ove 120° F (48° projectile haz e. Containers in e heat of fire. extinguished.	C). Cool ards when may rupture Keep	130				
5.2	Extinguishing Methods:	Level 1 Aero uninvolved of bursting. If a and release of containers of Water Fog, F As in any fire demand_an	5. FIREFIGHTING MEASURES sol (NFPA 30B). Aerosols may burst at temperatures about ontainers to prevent possible bursting. Aerosols may be perosols are bursting, stay clear until bursting is complete flammable liquids and/or exposed gases if exposed to the pollopy spraying them with water until the fire has been endoam, CO ₂ , Dry Chemical et wear MSHA/NIOSH approved self-contained breathing d full protective gear. Keep containers cool until well after the solution of the second self-container cool until well after the solution of the second self-container cool until well after the solution of the second self-container cool until well after the solution of the self-container cool until well after the solution of the self-container cool until well after the solution of the self-container cool until well after the solution of the self-container cool until well after the solution of the self-container cool until well after the solution of the self-container cool until well after the self-container cool until t	ove 120° F (48° e projectile haz e. Containers in the heat of fire. extinguished. apparatus (proter the fire is o	C). Cool ards when may rupture Keep essure-ut. Use	1 30				
5.2	Extinguishing Methods:	Level 1 Aero uninvolved of bursting. If a and release of containers of Water Fog, F As in any fire demand_an water spray	5. FIREFIGHTING MEASURES sol (NFPA 30B). Aerosols may burst at temperatures about ontainers to prevent possible bursting. Aerosols may be derosols are bursting, stay clear until bursting is complete flammable liquids and/or exposed gases if exposed to the policy spraying them with water until the fire has been eleman, CO ₂ , Dry Chemical exposed self-contained breathing diffull protective gear. Keep containers cool until well after to cool fire-exposed surfaces and to protect personnel.	ove 120° F (48° e projectile haz e. Containers in the heat of fire. extinguished. apparatus (proter the fire is of Fight fire upwi	C). Cool ards when may rupture Keep essure-ut. Use nd. Prevent	1 30				
5.1	Extinguishing Methods:	Level 1 Aero uninvolved of bursting. If a and release of containers of Water Fog, F As in any fire demand_an water spray runoff from	5. FIREFIGHTING MEASURES sol (NFPA 30B). Aerosols may burst at temperatures about ontainers to prevent possible bursting. Aerosols may be derosols are bursting, stay clear until bursting is completed flammable liquids and/or exposed gases if exposed to the cool by spraying them with water until the fire has been endown, CO ₂ , Dry Chemical 12, wear MSHA/NIOSH approved self-contained breathing did full protective gear. Keep containers cool until well after the cool fire-exposed surfaces and to protect personnel. In the fire control or dilution from entering sewers, drains, dring the cool state of the control or dilution from entering sewers, drains, dring the cool state of the control or dilution from entering sewers, drains, dring the cool state of the cool	ove 120° F (48° e projectile haz e. Containers is e heat of fire. extinguished. apparatus (proter the fire is o Fight fire upwiking water sup	C). Cool ards when may rupture Keep essure-ut. Use nd. Prevent oply, or any	1 0				
5.2	Extinguishing Methods:	Level 1 Aero uninvolved of bursting. If a and release of containers of Water Fog, F As in any fire demand_an water spray runoff from of natural water	5. FIREFIGHTING MEASURES sol (NFPA 30B). Aerosols may burst at temperatures about ontainers to prevent possible bursting. Aerosols may be derosols are bursting, stay clear until bursting is complete flammable liquids and/or exposed gases if exposed to the policy spraying them with water until the fire has been eleman, CO ₂ , Dry Chemical exposed self-contained breathing diffull protective gear. Keep containers cool until well after to cool fire-exposed surfaces and to protect personnel.	ove 120° F (48° e projectile haz e. Containers is e heat of fire. extinguished. apparatus (proter the fire is o Fight fire upwiking water supiloSH-approved	C). Cool ards when may rupture Keep essure-ut. Use nd. Prevent oply, or any d positive	1 0				
5.2	Extinguishing Methods:	Level 1 Aero uninvolved of bursting. If a and release of containers of Water Fog, F As in any fire demand_ an water spray runoff from natural wate pressure self	5. FIREFIGHTING MEASURES sol (NFPA 30B). Aerosols may burst at temperatures about ontainers to prevent possible bursting. Aerosols may be serosols are bursting, stay clear until bursting is complete flammable liquids and/or exposed gases if exposed to the bool by spraying them with water until the fire has been estoam, CO ₂ , Dry Chemical et al., wear MSHA/NIOSH approved self-contained breathing did full protective gear. Keep containers cool until well aft to cool fire-exposed surfaces and to protect personnel. In fire control or dilution from entering sewers, drains, dring trway. Firefighters must use full bunker gear including N	ove 120° F (48° e projectile haz e. Containers is e heat of fire. extinguished. apparatus (proter the fire is o Fight fire upwiking water supiloSH-approved	C). Cool ards when may rupture Keep essure-ut. Use nd. Prevent oply, or any d positive	1 0				
5.2	Extinguishing Methods:	Level 1 Aero uninvolved of bursting. If a and release of containers of Water Fog, F As in any fire demand_ an water spray runoff from natural wate pressure self	5. FIREFIGHTING MEASURES sol (NFPA 30B). Aerosols may burst at temperatures about ontainers to prevent possible bursting. Aerosols may be serosols are bursting, stay clear until bursting is complete flammable liquids and/or exposed gases if exposed to the bool by spraying them with water until the fire has been estoam, CO ₂ , Dry Chemical et al., wear MSHA/NIOSH approved self-contained breathing defull protective gear. Keep containers cool until well afto to cool fire-exposed surfaces and to protect personnel. If the control or dilution from entering sewers, drains, dring the surfaces are full bunker gear including New contained breathing apparatus to protect against poters.	ove 120° F (48° e projectile haz e. Containers is e heat of fire. extinguished. apparatus (proter the fire is o Fight fire upwiking water supiloSH-approved	C). Cool ards when may rupture Keep essure-ut. Use nd. Prevent oply, or any d positive	1 0				
5.2	Extinguishing Methods:	Level 1 Aero uninvolved of bursting. If a and release of containers of Water Fog, F As in any fire demand_ an water spray runoff from natural wate pressure self	5. FIREFIGHTING MEASURES sol (NFPA 30B). Aerosols may burst at temperatures about ontainers to prevent possible bursting. Aerosols may be serosols are bursting, stay clear until bursting is complete flammable liquids and/or exposed gases if exposed to the bool by spraying them with water until the fire has been estoam, CO ₂ , Dry Chemical et al., wear MSHA/NIOSH approved self-contained breathing defull protective gear. Keep containers cool until well afto to cool fire-exposed surfaces and to protect personnel. If the control or dilution from entering sewers, drains, dring the surfaces are full bunker gear including New contained breathing apparatus to protect against poters.	ove 120° F (48° e projectile haz e. Containers is e heat of fire. extinguished. apparatus (proter the fire is o Fight fire upwiking water supiloSH-approved	C). Cool ards when may rupture Keep essure-ut. Use nd. Prevent oply, or any d positive	1 0				
5.2	Extinguishing Methods: Firefighting Procedures:	Level 1 Aero uninvolved of bursting. If a and release of containers of Water Fog, F As in any fire demand_ an water spray runoff from natural wate pressure self or decomposi	5. FIREFIGHTING MEASURES sol (NFPA 30B). Aerosols may burst at temperatures about ontainers to prevent possible bursting. Aerosols may be derosols are bursting, stay clear until bursting is complete flammable liquids and/or exposed gases if exposed to the bool by spraying them with water until the fire has been end of the bool by spraying them with water until the fire has been end of the bool by spraying them with water until the fire has been end of the bool by spraying them with water until the fire has been end of the bool by spraying them with water until the fire has been end of the bool by spraying them with water until the fire has been end of the bool by spraying them with water until the fire has been end of the bool by spraying them with water until the fire has been end of the bool by spraying them with water until the fire has been end of the bool by spraying them with water until the fire has been end of the bool by spraying them with water until the fire has been end of the bool by spraying them with water until the fire has been end of the bool by spraying them with water until the fire has been end of the bool by spraying them with water until the fire has been end of the bool by spraying them with water until the fire has been end of the bool by spraying them with water until the fire has been end of the bool by spraying them with water until the fire has been end of the bool by spraying them with water until the fire has been end of the bool by spraying them with water until the fire has been end of the bool by spraying them with water until bursting is completed. In the bool by spraying them with water until bursting is completed to the bool by spraying them with water until bursting is completed to the bool by spraying them with water until bursting is completed to the bool by spraying them with water until bursting is completed to the bool by spraying them with water until bursting is completed to the bool by spraying them with water until bursting is completed to the bool by spraying them	ove 120° F (48° e projectile haz e. Containers is e heat of fire. extinguished. apparatus (protect the fire is o Fight fire upwiking water supplies in the fire is o heat of the fire is o heat of the fire is o heat of the fire upwiking water supplies in the fire is o heat of the fire is on the	C). Cool ards when may rupture Keep essure-ut. Use nd. Prevent oply, or any d positive combustion	1 0				
5.2	Extinguishing Methods:	Level 1 Aero uninvolved of bursting. If a and release of containers of Water Fog, F As in any fire demand_ an water spray runoff from natural wate pressure self or decomposi	5. FIREFIGHTING MEASURES sol (NFPA 30B). Aerosols may burst at temperatures about ontainers to prevent possible bursting. Aerosols may be derosols are bursting, stay clear until bursting is complete flammable liquids and/or exposed gases if exposed to the pool by spraying them with water until the fire has been end on the pool by spraying them with water until the fire has been end on the pool of t	ove 120° F (48° e projectile haz e. Containers is e heat of fire. extinguished. apparatus (protect the fire is o Fight fire upwiking water supplies in the fire is o heat of the fire is o heat of the fire is o heat of the fire upwiking water supplies in the fire is o heat of the fire is on the	C). Cool ards when may rupture Keep essure-ut. Use nd. Prevent oply, or any d positive combustion	1 Protective				
5.2	Extinguishing Methods: Firefighting Procedures:	Level 1 Aero uninvolved of bursting. If a and release of containers of Water Fog, F As in any fire demand_ an water spray runoff from natural wate pressure self or decompose Before clean Equipment (5. FIREFIGHTING MEASURES sol (NFPA 30B). Aerosols may burst at temperatures about ontainers to prevent possible bursting. Aerosols may be derosols are bursting, stay clear until bursting is complete flammable liquids and/or exposed gases if exposed to the pool by spraying them with water until the fire has been endoam, CO ₂ , Dry Chemical et al., wear MSHA/NIOSH approved self-contained breathing diffull protective gear. Keep containers cool until well after to cool fire-exposed surfaces and to protect personnel. If the control or dilution from entering sewers, drains, dring arrway. Firefighters must use full bunker gear including New contained breathing apparatus to protect against potentiation products and oxygen deficiencies. 6. ACCIDENTIAL RELEASE MEASUR ing any spill or leak, individuals involved in spill cleanup in PPE).	ove 120° F (48° e projectile haz e. Containers is e heat of fire. e heat of fire. extinguished. Tapparatus (protect the fire is o Fight fire upwiking water supplied in the fire is o Fight fire upwiking water supplied in the fire is o Fight fire upwiking water supplied in the fire is o Fight fire upwiking water supplied in the fire is o Fight fire upwiking water supplied in the fire is of the	C). Cool ards when may rupture Keep essure-ut. Use nd. Prevent oply, or any d positive combustion					
5.2	Extinguishing Methods: Firefighting Procedures:	Level 1 Aero uninvolved of bursting. If a and release of containers of Water Fog, F As in any fire demand_ an water spray runoff from natural wate pressure self or decompose Before clean Equipment (Small spills V	5. FIREFIGHTING MEASURES sol (NFPA 30B). Aerosols may burst at temperatures about ontainers to prevent possible bursting. Aerosols may be derosols are bursting, stay clear until bursting is complete flammable liquids and/or exposed gases if exposed to the pool by spraying them with water until the fire has been exposed. Dry Chemical exposed surfaces and to protective gear. Keep containers cool until well after to cool fire-exposed surfaces and to protect personnel. If the control or dilution from entering sewers, drains, dring reway. Firefighters must use full bunker gear including New contained breathing apparatus to protect against potentiation products and oxygen deficiencies. 6. ACCIDENTIAL RELEASE MEASUR ing any spill or leak, individuals involved in spill cleanup of the ppe). Wear appropriate personal protective equipment includir	ove 120° F (48° e projectile haz e. Containers de heat of fire. e heat of fire. extinguished. Tapparatus (proter the fire is of Fight fire upwiking water supplied in the fire is of Fight fir	C). Cool ards when may rupture Keep essure-ut. Use nd. Prevent oply, or any d positive combustion eropriate Persona protective eyewea	ar. Use a non-				
5.2	Extinguishing Methods: Firefighting Procedures:	Level 1 Aero uninvolved of bursting. If a and release of containers of Water Fog, F As in any fire demand_ an water spray runoff from natural wate pressure self or decomposi	5. FIREFIGHTING MEASURES sol (NFPA 30B). Aerosols may burst at temperatures about ontainers to prevent possible bursting. Aerosols may be derosols are bursting, stay clear until bursting is complete flammable liquids and/or exposed gases if exposed to the color by spraying them with water until the fire has been exposed. Dry Chemical exposed self-contained breathing defull protective gear. Keep containers cool until well after to cool fire-exposed surfaces and to protect personnel. If the control or dilution from entering sewers, drains, dring the control or dilution from entering sewers, drains, dring the contained breathing apparatus to protect against potential products and oxygen deficiencies. 6. ACCIDENTIAL RELEASE MEASUR ing any spill or leak, individuals involved in spill cleanup of the products appropriate personal protective equipment including material such as vermiculite or sand to soak up the products and to soak up the produc	ove 120° F (48° e projectile haz e. Containers e heat of fire. e heat of fire. extinguished. apparatus (proter the fire is o Fight fire upwiking water supplication of the fire is o Fight fire upwiking water supplication hazardous extended that is a province of the fire is o Fight fire upwiking water supplication of the fire is o Fight fire upwiking water supplication of the fire is of the fir	C). Cool ards when may rupture Keep essure-ut. Use nd. Prevent oply, or any d positive combustion eropriate Persona protective eyewer into a container f	ar. Use a non- or later disposal.				
5.2	Extinguishing Methods: Firefighting Procedures:	Level 1 Aero uninvolved of bursting. If a and release of containers of Water Fog, F As in any fire demand_ an water spray runoff from natural wate pressure self or decompose Before clean Equipment (Small spills V combustible not use water	5. FIREFIGHTING MEASURES sol (NFPA 30B). Aerosols may burst at temperatures about ontainers to prevent possible bursting. Aerosols may be derosols are bursting, stay clear until bursting is complete flammable liquids and/or exposed gases if exposed to the pool by spraying them with water until the fire has been end on the pool by spraying them with water until the fire has been end on the pool of t	ove 120° F (48° e projectile haze. Containers in the heat of fire. extinguished. apparatus (protect the fire is of Fight fire upwinking water supplied in the heat of the hea	C). Cool ards when may rupture Keep essure-ut. Use nd. Prevent oply, or any d positive combustion eropriate Persona protective eyewer into a container faterial using non-	ar. Use a non- or later disposal. sparking material				
5.2	Extinguishing Methods: Firefighting Procedures:	Level 1 Aero uninvolved of bursting. If a and release of containers of Water Fog, F As in any fire demand_ an water spray runoff from natural wate pressure self or decompose Before clean Equipment (Small spills V combustible not use wate (e.g., plastic	5. FIREFIGHTING MEASURES sol (NFPA 30B). Aerosols may burst at temperatures about ontainers to prevent possible bursting. Aerosols may be derosols are bursting, stay clear until bursting is complete flammable liquids and/or exposed gases if exposed to the pool by spraying them with water until the fire has been end of the pool by spraying them with water until the fire has been end of the pool of t	ove 120° F (48° e projectile haze. Containers le heat of fire. extinguished. apparatus (proter the fire is of Fight fire upwiking water supplost-approved thial hazardous) ES must wear appluct and place. Sweep up mainer or plastic	C). Cool ards when may rupture Keep essure-ut. Use nd. Prevent oply, or any d positive combustion propriate Persona protective eyewer into a container faterial using non-timer within anot	ar. Use a non- for later disposal. sparking material her container.				
i.3	Extinguishing Methods: Firefighting Procedures:	Level 1 Aero uninvolved of bursting. If a and release of containers of Water Fog, F As in any fire demand_ an water spray runoff from natural wate pressure self or decomposi Before clean Equipment (Small spills V combustible not use wate (e.g., plastic Large spills:	5. FIREFIGHTING MEASURES sol (NFPA 30B). Aerosols may burst at temperatures about ontainers to prevent possible bursting. Aerosols may be derosols are bursting, stay clear until bursting is complete flammable liquids and/or exposed gases if exposed to the pool by spraying them with water until the fire has been end on the pool by spraying them with water until the fire has been end on the pool of t	ove 120° F (48° e projectile haze. Containers le heat of fire. extinguished. apparatus (proter the fire is of Fight fire upwiking water supposed in the fire is of Fight fire upwiking water supposed in the fire is of Fight fire upwiking water supposed in the fire is of Fight fire upwiking water supposed in the fire u	C). Cool ards when may rupture Keep essure-ut. Use nd. Prevent oply, or any d positive combustion propriate Persona protective eyewer into a container faterial using non-liner within anot Stay upwind and	ar. Use a non- or later disposal. sparking material her container. d away from spill				



06701-06710-07701-07710

Prepared to OSHA, ACC, ANSI, NOHSC, WHMIS, 2001/58 & 1272/2008/EC Standards SDS Revision: 1.0 SDS Revision Date: 05/02/2018

		7. HANDLING									
		Do not eat, drink, or smoke while handling this product. Contents under pressure. Handle as to avoid puncturing									
7.1	Work & Hygiene Practices	container(s). When used as intended, no additional protective equipment is necessary. Use chemical goggles if eye									
		contact is possible. Wash unintentional residues with soap and warm water.									
7.2	Storago and Handling	Use and store in a cool, dry, well-ventilated location (e.g., local exhaust ventilation, fans) away from heat and direct sunlight. Avoid temperatures above 120 °F (48°C). Keep away from incompatible substances. Protect containers from									
1.2	Storage and Handling:	physical damage. To avoid unir									italileis iroili
7.3	Special Precautions:	Spilled material may present a								CI 1.	
7.5	Special Freedations.	Spined material may present a	nipping i	iazara ii	icit anatti	criaca. Cici	ari un spins	prompti	у.		
		8. EXPOSURE CON	TROL	S & P	ERSON	IAL PRO	OTECTIO	NC			
8.1	Exposure Limits:		AC	GIH		NOHSC			OSHA		OTHER
	Ppm (mg/m ³)	Chemical Name(s)	TLV	STEL	ES-TWA	ES-STEL	ES-PEAK	PEL	STEL	IDLH	
i		Ethanol (SD Alcohol 40B)	1000	3000	1000	1800	NF	1000	1900	3300	
		DIFLUOROETHANE (R-152a)	1000	NA	1000	NA	NA	NE	NA	NA	
		DIMETHYL ETHER	NA	NA	400	760	NF	NA	NA	NA	
8.2	Ventilation & Engineering	General mechanical (e.g., fans)									•
	Controls	exhaust ventilation to effective	ly remov	e and pr	event buil	dup of vapo	ors or mist	generate	d from th	ne handl	ing of this
		product.									
8.3	Respiratory Protection:	No special respiratory protection									
		handling. In instances where d							_		
		protection is needed, use only							S.		
		State regulations, or the Canad				and applica	bie standai	ras or			
8.4	Tuo Drotoctions	Canadian Provinces, EC members None required under normal co				contact C	afatu alass	م دامی اط	1		
0.4	Eye Protection:	I			•						
		be used when handling or using	g large qu	iantities	or triis pro	oduct (e.g.,	<u>></u> 1 gallon (3.6 L)).			
8.5	Hand Protection:	None required under normal co	nditions	of use.	However.	may cause	skin irritati	on is son	ne		
		sensitive individuals. When ha									<u>M</u>
		nitrile or impervious plastic glo	_	Se daa	(0.8.	, <u> </u>	(5.5 =///		,		(1
		Sie Program Bro									
8.6	Body Protection:	No apron required when handl	ng small	quantiti	es. When	handling la	rge quantit	ties (e.g.,	>		
	,	5 lbs.), eye wash station and de									
		work activities involving large q	uantities	of this p	roduct, w	ash any exp	oosed areas	5			
		horoughly with soap and water.									
		9. PHYSICA	L & CI	НЕМІ	CAL PR	OPERT	IES				
9.1	Appearance:	Aerosol, misty spray									
9.2	Odor:	Fresh Sweet odor									
9.3	Odor Threshold	NA									
9.4	pH:	NA									
9.5	Melting/Freezing Point	NA									
9.6	Initial Boiling Point/ Boiling	NA									
	Range:										
9.7	Flashpoint:	-30 °F (-34 °C) TCC for propellar	nt only; 3	5.6 °F (2	⁰ C) EPA m	ethod 1010) Concentra	te only			
9.8	Upper/Lower Flammability		•	-	•			•			
	limits										
9.9	Vapor Pressure:	@ 20 °C (68° F) – Can pressure	not to ex	ceed 180) psig @ 5	5 °C (131 °F	12.4 bar	•			
9.10	Vapor Density	>1									
9.11	Relative Density:	0.85 – 0.95									
	Solubility:	Soluble									
9.13	Partition Coefficient	NA									
	(log P _{ow}):										
	Autoignition Temperature:	NA									
9.15	Decomposition	NA									
	Temperature.										
	Viscosity:	Aerosol at ambient temperature									
9.17	Other Information:	Evaporation Rate >1; VOC: < 55	%								



06701-06710-07701-07710

Prepared to OSHA, ACC, ANSI, NOHSC, WHMIS, 2001/58 & 1272/2008/EC Standards SDS Revision: 1.0 SDS Revision Date: 05/02/2018

		10. STABILITY & REACTIVITY					
10.1	Stability:	Stable at normal temperatures.					
	Hazardous Decomposition Products:	Oxides of carbon (CO, CO ₂) and sulfur (SO ₂)					
10.3	Hazardous Polymerization:	Will not occur.					
10.4	•	Excessive heat, direct sunlight, flames, heat sources and incompatible substances.					
10.5		Mixture with strong acids, alkalis or oxidizers.					
1	•						
		11. TOXICOLOGICAL INFORMATION					
11.1	Routes of Entry:	Inhalation: YES Absorption: YES Ingestion: YES					
11.2	Toxicity Data:	This product was not tested on animals.					
11.3	Acute Toxicity:	See Section 4.4					
11.4	Chronic Toxicity:	See Section 4.5					
	Suspected Carcinogen:	NA					
11.6	Reproductive Toxicity:	This product is not reported to cause reproductive toxicity in humans.					
	Mutagenicity:	This product is not reported to produce mutagenic effects in humans.					
	Embryotoxicity:	This product is not reported to produce embryotoxic effects in humans.					
	Teratogenicity:	This product is not report to cause teratogenic effects in humans.					
	Reproductive Toxicity:	This product is not report to cause reproductive effects in humans.					
	Irritancy of Product:	See Section 4.3					
11.8	Biological Exposure Indices:	NA					
11.9	Physician Recommendations:	Treat symptomatically.					
		12. ECOLOGICAL INFORMATION					
12.1	Environmental Stability:	There is no specific data available for this product.					
	Effects on Plants & Animals	There is no specific data available for this product.					
12.3	Effects on Aquatic Life:	The product itself has not been tested as a whole. There is no specific data available for this product.					
		13. DISPOSAL CONSIDERATIONS					
13.1	Waste Disposal:	Review current local, state and federal laws, codes, statutes and regulations to determine current status and					
13.1	waste bisposai.	appropriate disposal method for the ingredients listed in Section 2. Any disposal practice must be in compliance with					
		local, state and federal laws and regulations. Contact the appropriate agency for specific information. A licensed facili					
		or waste hauler must provide treatment, transport, storage and disposal of hazardous waste.					
13.2	Special Considerations:	U.S. EPA Hazardous Waste – Characteristic – Ignitable (D001)					
. = 1	,	U					
		14. TRANSPORTATION INFORMATION					
14.1	49 CFR (GND):	UN1950, AEROSOLS, 2.1 (LTD QTY, IP VOL < 1.0 L); or					
		CONSUMER COMMODITY, ORM-D (IP VOL \leq 1.0 L) – until 12/31/2020					
14.2	IATA (AIR)	UN1950, AEROSOLS, FLAMMABLE, 2.1 (LTD QTY, IP VOL < 0.5 L); or					
		ID8000, CONSUMER COMMODITY, ORM-D (IP VOL < 0.5 I=L)					
14.3	IMDG (OCN):	UN1950, AEROSOLS, 2.1 (LTD QTY, IP VOL < 1.0 L)					
14.4	TDGR (Canadian GND):	UN1950, AEROSOLS, 2.1 (LTD QTY, IP VOL ≤ 1.0 L); or MARK PACKAGE "LIMITED QUANTITY", "LTD QTY", OR "QUANT LTÉE" OR "QUANTITÉ LIMITÉE"					
14 5	ADR/RID (EU):	UN1950, AEROSOLS, 2.1 (LTD QTY, IP VOL \leq 1.0 L)					
	SCT (MEXICO):	UN1950, AEROSOLES, 2.1 (CANTIDAD LIMITADA, IP VOL < 1.0 L)					
	ADGR (AUS):	THE SOUTH AND TH					
17./	Abdit (Abd).	UN1950, AEROSOLS, 2.1 (LTD QTY, IP VOL \leq 1.0 L)					



06701-06710-07701-07710

Prepared to OSHA, ACC, ANSI, NOHSC, WHMIS, 2001/58 & 1272/2008/EC Standards SDS Revision: 1.0 SDS Revision Date: 05/02/2018

		15. REGULATORY INFOR	MATION					
15.1	SARA Reporting	SATA Title III, section 313 reporting requirements.						
	Requirements:	This product does not contain any substance subject to s	with the my section 313 reporting requirements.					
15.2	SARA Threshold Planning Quantity:	There are no specific Threshold Planning Quantities for the components of this product.						
15.3		The components of this product are listed on the TSCA Inventory.						
	CERCLA Reportable Quantity (RQ):	Ethanol: 2270 kg; 5000 lbs						
15.5		This product complies with the appropriate sections of the Food and Drug Administration's 21 CFR Subchapter G. (Cosmetics)						
15.6	Other Canadian Regulations:	This product has been classified according to the hazard criteria of the CPR and the SDS contains all of the information required by the CPR. The components of the product are listed on the DSL/NDSL. None of the components of this product are listed on the Priorities Substance List. WHMIS Class B5 (Flammable Aerosol)						
15.7	State Regulatory Information:	Ethanol: is found on the following state criteria lists FL, MA, MN, NJ, PA, and WA Dimethyl Ethet can be found on the following state criteria lists: MA, MN, PA, WA and NJ Difluoroethane can be found on the following state criteria lists: MA and NJ No other ingredients of this product, present in a concentration of 1.0% or greater, are listed on any of the following state criteria lists: California Proposition 65 (CA65), Delaware Air Quality Management List (DE), Florida Toxic Subst List (FL), Massachusetts Hazardous Substances List (MA), Michigan Critical Substances List (MI), Minnesota Hazardous Substances List (MN), New Jersey Right-to-Know List (NJ), New York Hazardous Substances List (NY), Pennsylvania F to-Know List (PA), Washington Permissible Exposures List (WA), Wisconsin Hazardous Substances List (WI).						
15.8	Other Requirements:	The primary components of this product are listed in Antalandra Dimethyl Ether: Flammable (F+). Risk Phrases (R) 12 – Keep out of reach of children. Keep cool store below 12 ignition – No smoking. Ethanol: Flammable (F). Risk Phrases (R): 11 – Flammabl children. Keep container tightly closed. Keep away from	Highly Flammable. Safety Phrases (S): 2-6-16 – 0 OF (48.8 OC). Keep away from sources of e. Safety Phrase (S): 2-7-16 – Keep out of reach of					
		16. OTHER INFORMA	TION					
16.1		WARNING! FLAMMABLE AEROSOL. PRESSURIZED CON AND VAPORS. CAUSES EYE IRRITATION. Keep away fro sources. No Smoking. Do not spray on an open flame or Avoid breathing vapor/spray. Wash thoroughly with soa Wear eye protection. Protect from sunlight. Do not exp Remove person to fresh air and keep comfortable for breminutes. Remove contact lenses if present and easy to advice/attention. KEEP PRODUCT LOCKED-UP AND OUT	m heat, hot surfaces, sparks open flames and other ignition of other ignition source. Do not pierce or burn, even after use. In an analysis of the second of					
	Terms & Definitions:	See last page of this Safety Data Sheet.						
16.3	Disclaimer:	government regulations must be reviewed for applicabil knowledge, the information contained herein is reliable complete=ness are not guaranteed and no warranties of information contained herein relates only to the specific	tard Communication Standard, 29 CFR §1910.1200. Other lity to this product. To the base of KIK Custom Product's and accurate as of this date; however, accuracy, suitability or any type, either expressed or implied, are provided. The product(s). If this product(s) is combined with other materials, y be changed from time to time. Be sure to consult the latest					
16.4	Prepared By:	KIK Custom Products 2030 Old Candler Road Gainesville, GA 30507 USA Tel: +1 (770) 534-0300 Fax: +1 (770) 534-8954 http://www.kikcorp.com	KIK CUSTOM PRODUCTS					




06701-06710-07701-07710

Prepared to OSHA, ACC, ANSI, NOHSC, WHMIS, 2001/58 & 1272/2008/EC Standards

SDS Revision: 1.0

SDS Revision Date: 05/02/2018

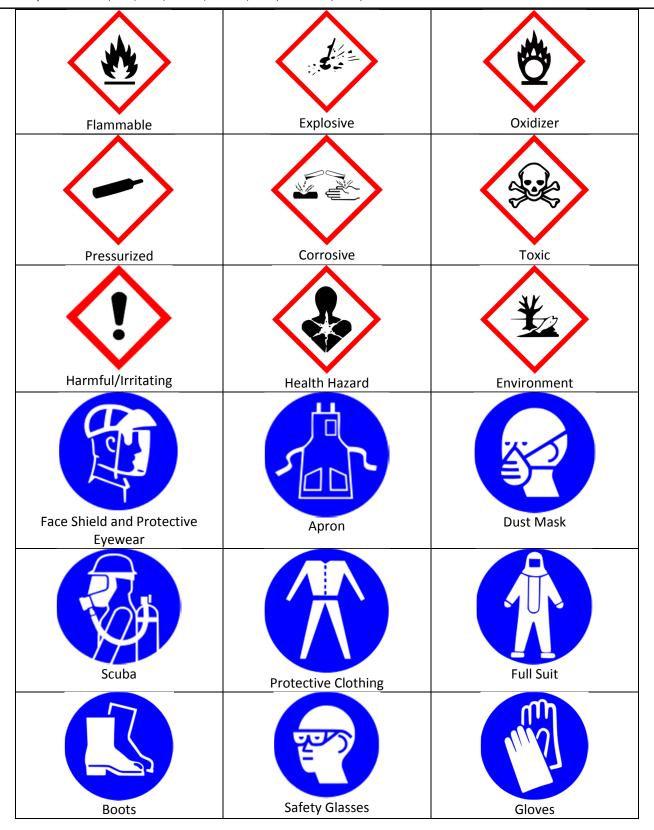



06701-06710-07701-07710

Prepared to OSHA, ACC, ANSI, NOHSC, WHMIS, 2001/58 & 1272/2008/EC Standards

SDS Revision: 1.0

SDS Revision Date: 05/02/2018

